




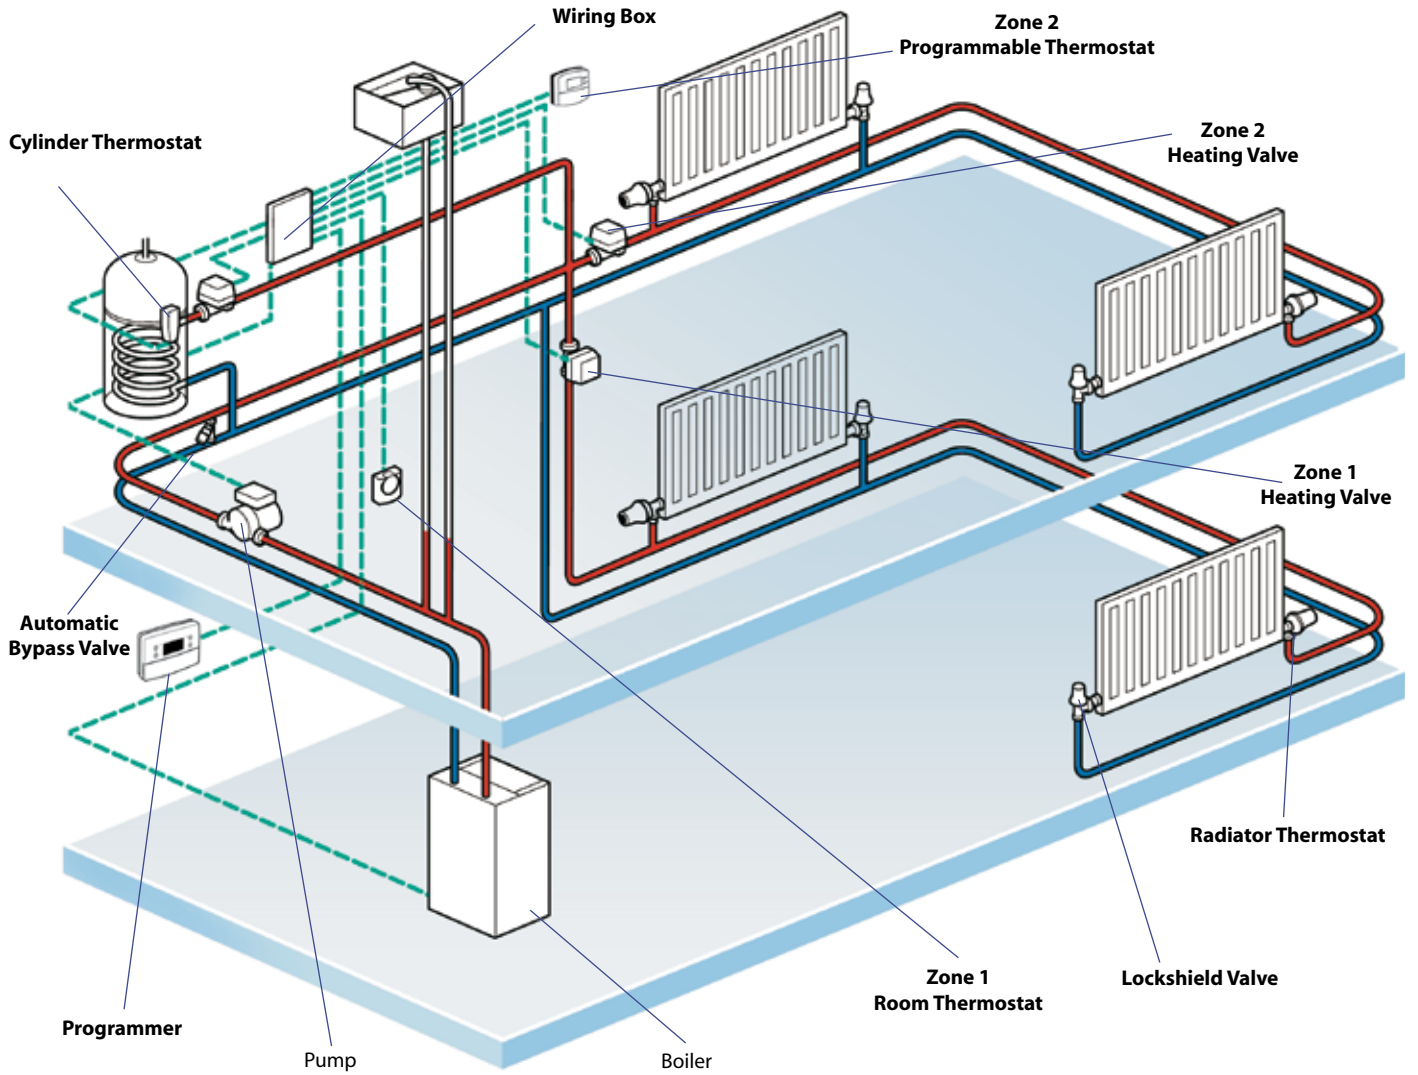

# Two Port Zone Valve System with Additional Heating Zone

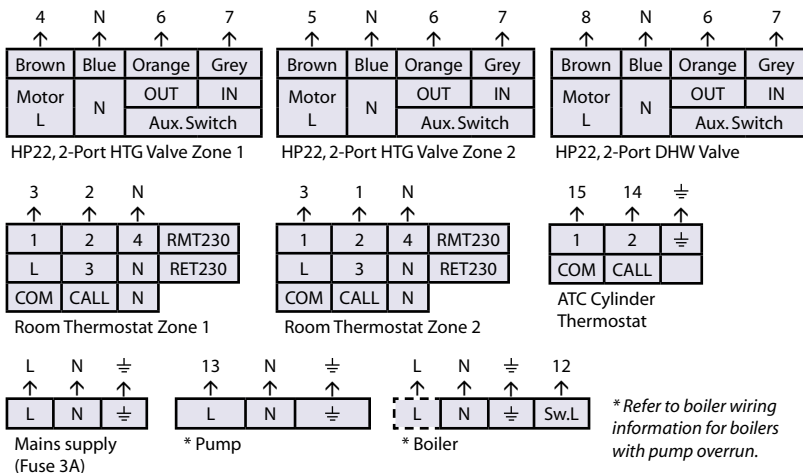

## Wiring Information

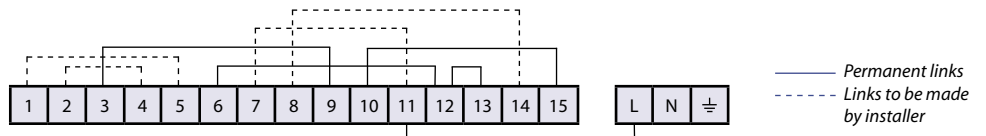

	⊥ ↑	N ↑	L ↑	11 ↑	10 ↑	9 ↑	Links
PROGRAMMER	⊥	N	L	ON	ON		
CP715 Si, FP715-Si & TP9	-	N	L	3	4		-
SET3M, SET3E & FP975	-	N	L	1	4		L-2 & 5
SET2E	-	N	L	1	4		L-2, 1-5
102, 102E5, 102E7	-	N	L	1	2		L-3
4033	⊥	7	6	4	2		1-6
3060 & 3020P	⊥	7	6	4	2		-
TIMESWITCH	<i>Note: When using units below link 11-9 on wiring centre</i>						
103, 103E5, 103E7	-	N	L	1	-		L-3
TS715 Si	-	N	L	4	-		L-1
SET1E	-	N	L	4	-		L-5

\* Refer to boiler wiring information for boilers with pump overrun.